

RECEIVED: 06/02/2026



Climate Action Energy Statement Terenure Village, Co. Dublin

28-01-2026

Reverie Developments Limited



RECEIVED: 06/02/2026

Terenure Village, Co. Dublin

Reverie Developments Limited

Climate Action Energy Statement

Project Number: 3303

CURRENT ISSUE:			
Issue no:	02	Issue Date:	28-01-2026
Sign Off	Originator:	Checker:	Reason for Issue:
Print Name:	Kieran Morley	Michael Lannon	Tender

RECEIVED: 06/02/2026

Table of Contents

1. Introduction.....	4
2. Proposed Development	4
3. Building Energy Rating.....	5
4. Utilities.....	5
5. Structure and Building Element	6
5.1. Fabric 'U' Values Dwelling Apartments.....	6
5.2. Air Permeability (Air Tightness against infiltration)	6
5.3. Secondary Heat Source.....	6
6. Building Services (M&E) Overview.....	7
6.1. Heating & Ventilation systems apartments.	7
6.2. Heating & Ventilation systems dwellings	8
6.3. Lighting	8
6.4. Drainage	8

1. Introduction

This document provides an overview of the development's energy strategy and relates to the sustainability and energy targets proposed for the project. The development will approach the energy design in an efficient manner that reduces energy demand initially through passive strategies such as an efficient envelope which in turn reduces the energy demands relating to items such as the heating system. This initial approach in reducing the energy demand significantly aids the project in obtaining the required energy goals. Performance criteria relating to the development's envelope are set out in the following document.

The energy systems design will also focus on specifying energy efficient equipment to ensure the day to day running of the energy systems is optimized to further enhance energy savings and the related energy cost. Specifications relating to efficient heating, lighting and auxiliary equipment are set out in the document.

The report sets out to demonstrate a number of methodologies in Energy Efficiency, Conservation and Renewable Technologies that will be employed in part or in combination with each other for this development. These techniques will be employed to achieve compliance with the building regulations Part L and NZEB standards currently in public consultation.

2. Proposed Development

(i) demolition of commercial buildings at Nos. 1-7 Templeogue Road (Eircode No. D6WW611) and unnamed commercial building fronting Templeogue Road (Eircode No. D6WX688); (ii) demolition of the party boundary wall and non-original single-storey rear returns to the residential buildings at Nos. 16-18 Terenure Road West and provision of new party/ boundary walls to the rear of these properties; (iii) construction of a part-four part-five storey mixed-use block with frontage to Terenure Road West and Templeogue Road comprising 36 no. apartments (13 no. one-bedroom & 23 no. two-bedroom units) and 165sq.m of commercial floor space; (iv) construction of a three storey residential block within the centre of the site comprising 9 no. apartments (2 no. one-bedroom & 7 no. two-bedroom units); (v) provision of an ESB substation accessible via Terenure Road West and provision of service/loading bay and new footpath on Terenure Road West; (vi) provision of surface level carparking areas (20 no. car spaces, 3 no. motorcycle spaces & 1 no. service bay) accessible via Templeogue Road; (vii) all ancillary works necessary to facilitate the development including boundary treatments, landscaping, SuDS drainage works, construction of pedestrian infrastructure, provision of bin/bicycle storage. All residential apartments will be served by private amenity space in the form of a balcony/terrace and will have shared access to an area of communal amenity space at surface level between the proposed blocks.

3. Building Energy Rating

As of 2006 all domestic buildings that were newly built and existing buildings that are for sale or rent require a BER (Building Energy Rating) certificate. The actual building energy rating is based on the primary energy used for one year and is classified on a scale of A1 to G with A1 being the most energy efficient. It also gives the anticipated carbon emissions for a year's occupation based on the type of fuel that the systems use. In order to identify Primary energy consumption of the building, the BER assesses energy consumed under the following headings:

- Building type (house, apartment etc.)
- Building orientation
- Thermal envelope (insulation levels of the façade, roofs, ground floor etc.)
- Air Permeability (how much air infiltrates into the building through the façade)
- Heating systems (what type of heat source is used and how efficient)
- Ventilation (what form of ventilation is used. Natural vent, mixed mode mechanical ventilation)
- Fan and pump efficiency (how efficient are the pumps and fans)
- Domestic hot water generation (is a high efficiency boiler used)
- Lighting systems (how efficient is the lighting in the building)

Through the specification of an energy efficient façade and HVAC systems, the energy consumption of the building will be reduced compared to a set baseline. This ensures the environmental and economic impact of the operation of the building is reduced. The key philosophy of this plan is to reduce energy consumption by firstly limiting the energy needed by improving the buildings insulation. The second step is to utilise energy in the most efficient way through the selection and installation of energy efficient plant and equipment. The final step is to introduce energy from renewable sources to reduce the burden on Fossil Fuels.

4. Utilities

Initial discussions have taken place with the ESB regarding existing infrastructure in the locality and existing overhead cables will be undergrounded. The preliminary loading for the site is estimated to be in the region of 250 kVA. (This is subject to change dependent on final renewable considerations etc.) Preliminary design estimates would indicate an MV substation and additional unit sub stations will be required.

5. Structure and Building Element

While the construction works will incur an initial investment, the lifetime running cost of the buildings will be considered to reduce water, fuel and electrical energy consumption. To that end methods will be explored to further improve the building's energy rating and reduce the carbon emissions. This includes decreasing the thermal conductivity (heat losses) of the building fabric, take advantage of passive solar gain to reduce the heating demand in the space and increase day lighting to reduce artificial lighting. Natural ventilation may be employed or if deemed as a requirement mechanical ventilation and heat recovery techniques will be employed to recover energy in the exhausted air. The following are some outline u-value specifications which will achieve the required energy specification:

5.1. Fabric 'U' Values Dwelling Apartments

- Walls - 0.18 W/m².K
- Window - 1.2 W/m².K (solar fraction (g factor) of 0.7, frame factor of 0.7 or better)
- Roof - 0.16 W/m².K (Flat roof)
- Doors - 1.4 W/m².K (This is to include frame)
- Ground Floor slab - 0.18 W/m².K
- Thermal Bridging - Factor of 0.15

5.2. Air Permeability (Air Tightness against infiltration)

One of the most significant heat loss factors in any buildings is through controlled and uncontrolled ventilation through the introduction of ambient/outside air into the heated space. The apartments are to be constructed with a high degree of air tightness to a possible value of 3m³/m²/hr or 0.15 Air Changes with a permeability test conducted post construction to demonstrate this level in accordance with the TGD's.

Dwelling houses are expected to achieve an air permeability level of 0.25 m³/hr/m² or less.

5.3. Secondary Heat Source

The dwellings do not contain a secondary heat source therefore this is not applicable.

6. Building Services (M&E) Overview

6.1. Heating & Ventilation systems apartments.

It is proposed to consider various options for Apartments to include air to water heat pumps or exhaust air heat pumps.

Air source heat pumps utilize low grade heat from external ambient air and transfer heat to heating system pipework. These systems operate with very high efficiencies (>400%) which provides significant carbon reductions in comparison to a traditional boiler system.

Exhaust air heat pumps utilise an exhaust air heat pump type system for heating, hot water and ventilation of the apartment units. This will re-cycle the heat from your house's ventilation system. These machines are ideal for apartments and more compact air-tight low energy or passive homes. Air is drawn through ducts to the heat pump from the bathrooms, utility and kitchen areas. The cold waste air is discharged to outside through another duct, and condensation to a drain. Additional heat generated internally from lighting, people and domestic appliances is also utilised through heat recovery.

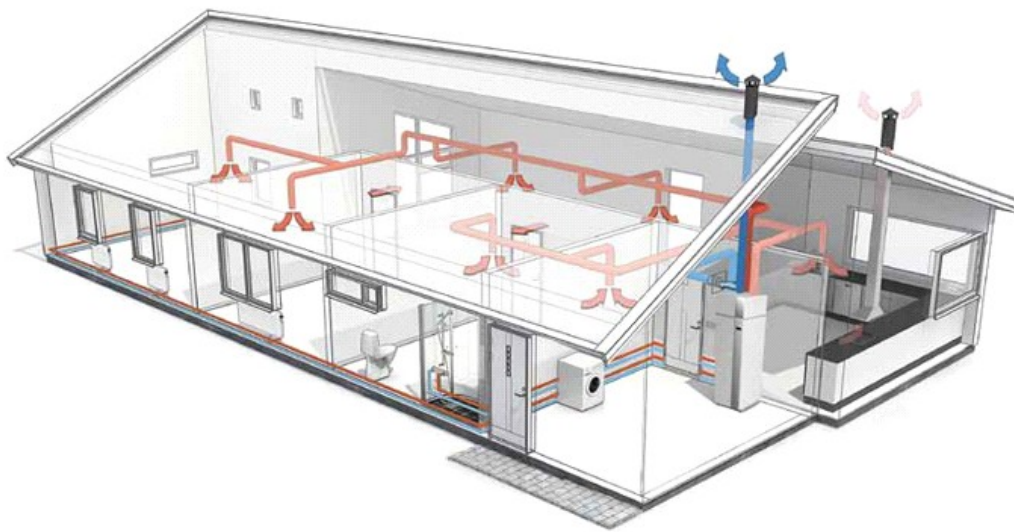


Figure 1: Typical Exhaust Air Source HP arrangement

For every unit of electricity used to operate the heat pump, up to four to five units of heat are generated. Therefore, for every unit of electricity used to generate heat, 4-5 (400-500%) units of heat are produced. Efficiencies in order of 600% may also be achieved depending on ambient conditions.

It is proposed to utilise radiator heating in the apartment units as heating emitters. These can be employed with heat pumps which utilise the low heating temperature from the

heat pump. A central time clock and separate time and temperature controls for each zone are to be provided (e.g. via 2-port valves). Such zones may consist of:

- Living areas,
- Bedrooms
- Domestic Hot water

6.2 Heating & Ventilation systems dwellings

The heating option that is under consideration for the dwelling units is an air to water heat pump and exhaust air heat pump.

Air source heat pumps utilize low grade heat from external ambient air and transfer heat to heating system pipework. These systems operate with very high efficiencies (>400%) which provides significant carbon reductions in comparison to a traditional boiler system.

6.3 Lighting

All lighting to be energy efficient with provision made for low energy lamps such as Compact Fluorescent Lamps (CFLs) which use 80% less electricity and last up to 10 times longer than ordinary light bulbs in the dwellings.

6.4 Drainage

An ecosystems services approach utilizing Sustainable Urban Drainage Systems (SuDS) to reduce runoff at source and apply site and regional SuDS measures to enhance water quality by the use of inter alia green roofs, rain gardens, bioretention measures/swales, tree trenches and water butts and other such measures;

Table 1: Summary of Part L compliance for Apartment units

	Typical Ground floor Apartments	Typical Mid & Top floors Apartments
<u>U-values</u>		
	W/m ² .K]	[W/m ² .K]
Floor [Max, Part L 2019 = 0.18]	0.18	N/A
	Floor to have minimum 100mm PIR with thermal conductivity of 0.022 W/m.K	
Roof [Max, Part L 2019] = 0.2 [Flat Roof]	N/A	0.16
	Flat roof insulation to be minimum 130mm Xtrodeck with thermal conductivity 0.021 W/m.K	
Wall [Max, Part L 2019 = 0.18]	0.18	0.18
	Wall insulation to comprise 110mm PIR board with thermal conductivity 0.022 W/m.K	
Door [Max, Part L 2019 = 1.4]	1.4	1.4
Window [Max Av, Part L 2019 = 1.4], solar factor 0.73	1.2	1.2
	Windows to south façade to have minimum solar factor of 0.5	
<u>Mechanical plant</u>		
Heating source	Exhaust air source heat pump.	Exhaust air source heat pump.
Heating controls	Time and temperature control of heating/hot water with individual heating zones	Time and temperature control of heating/hot water with individual heating zones
Heat emitters	Oversized radiators with mean water temperature 40 Deg C	Oversized radiators with mean water temperature 40 Deg C
Hot water cylinder	180 litre cylinder	180 litre cylinder

Ventilation	Centralised ducted extract system serving heat pump. Specific fan power 0.33 W/L/s minimum	Centralised ducted extract system serving heat pump. Specific fan power 0.33 W/L/s minimum
<u>Additional requirements</u>		
Lighting	100% energy efficient lighting	100% energy efficient lighting
Air permeability	Air permeability @ 3 m ³ /hr/m ²	Air permeability @ 3 m ³ /hr/m ²
Thermal bridging	Factor of 0.15 - Default	Factor of 0.15 - Default
Secondary heating	N/A	N/A
BER results	25 -49 (A2)	25 -49 (A2)
EPC [MPEPC = 0.3]	<0.3	<0.3
CPC [MPCPC = 0.35]	<0.35	<0.35
Renewable contribution [RER]	>0.2	>0.2